




15 TYP. SKEW BRACKET HAND RAIL SUPPORT DETAIL  
SCALE: 1:8

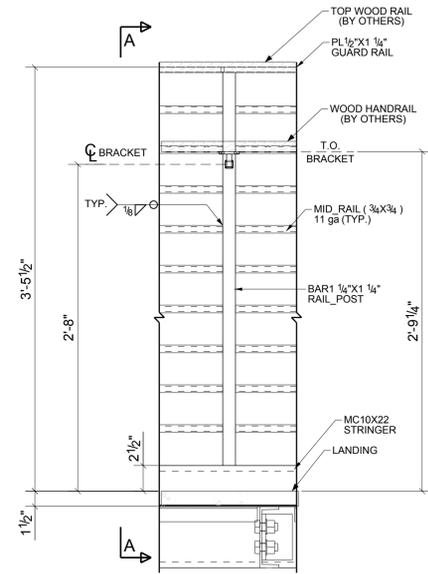


16 TYP. BRACKET AT LANDING HAND RAIL SUPPORT DET.  
SCALE: 1:8

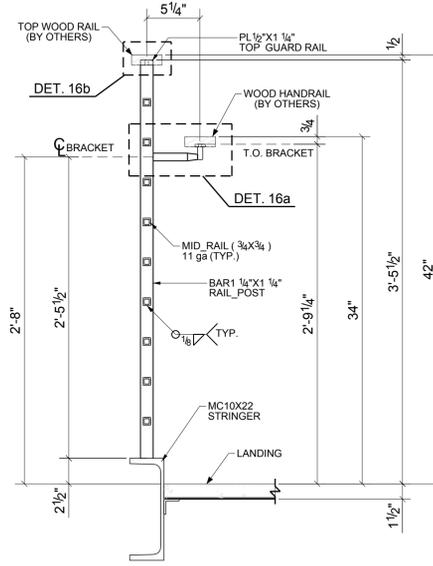


A SECTION  
SCALE: 1:8

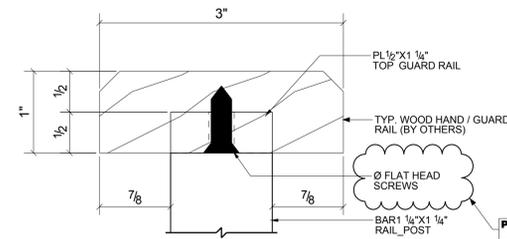


16b DETAIL  
SCALE: 1:1




ISOMETRIC VIEW  
N.T.S.

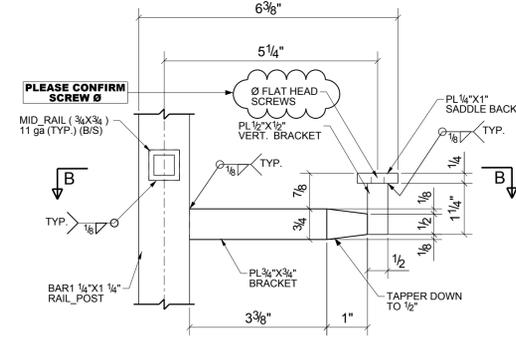


16a BRACKET DETAIL  
SCALE: 1:2

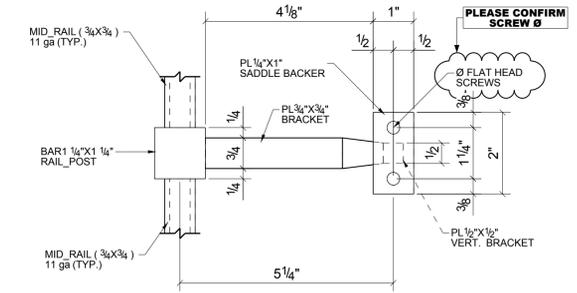


B SECTION  
SCALE: 1:2



17 TYP. BRACKET AT CORNER HAND RAIL SUPPORT DET.  
SCALE: 1:8

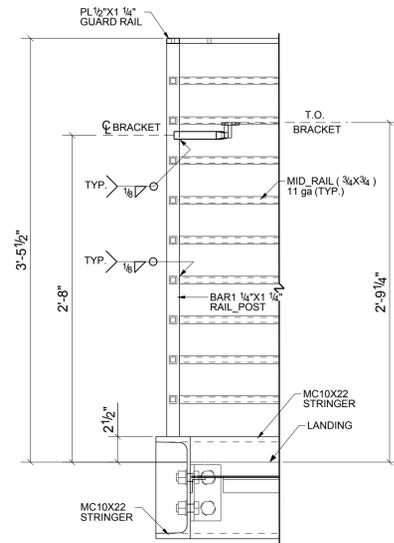


B SECTION  
SCALE: 1:8

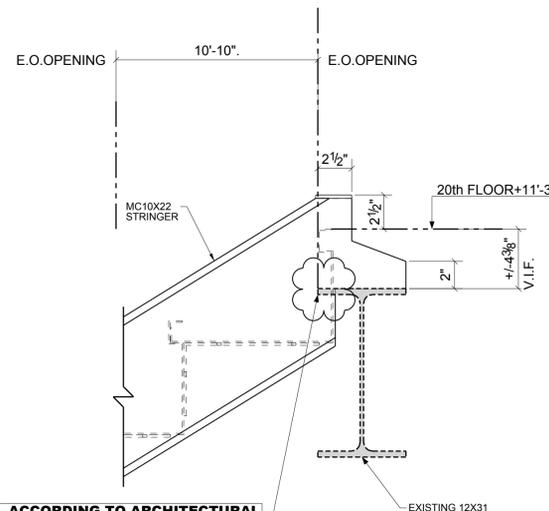


18 STG CONNECTION AT 20th FLOOR  
SCALE: 1:6

ACCORDING TO ARCHITECTURAL DRAWINGS DIMENSIONS AND STRUCTURAL SECTION 1/S-201.00, THE BEAM FLANGE WILL INTERFERE WITH RISER. PLEASE ADVISE.

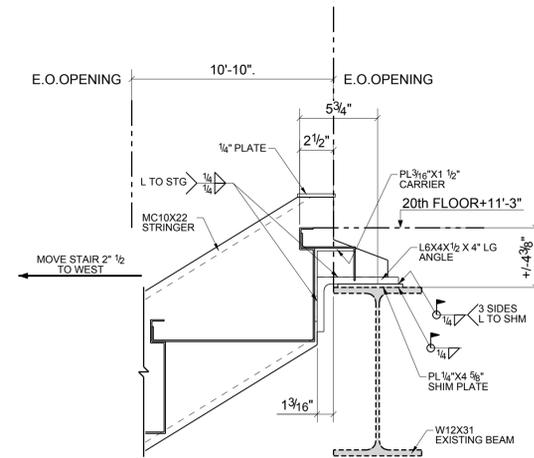

19 ALTERNATE STG CONNECTION AT 20th FLOOR  
SCALE: 1:6

APPROVER:  
STAIR WILL BE ABLE TO CLEAR THE EXISTING BEAM 12X31 IF THE STAIR IS SHIFTED 2 1/2" WEST.  
VERIFY IN FIELD ALL CONDITIONS IN ORDER TO CONFIRM THE 2 1/2" WEST MOVEMENT

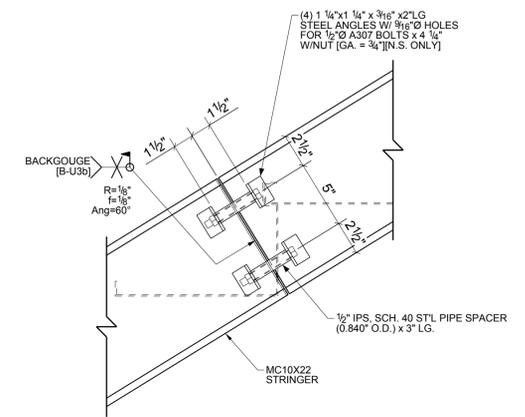

20 TYP. STRINGER FIELD SPLICE  
SCALE: 1:6